



Electronic water meter Qwater 5.5 in measuring capsule version

Electronic MID-conform meter for determining water consumption in water supply systems

The electronic water meter Q water 5.5 has been designed as a multi-jet dry running meter for a nominal flow of Q_3 2.5 m³/h.

There are a total of 11 product variants available for direct installation in connection interfaces (EATs) from different manufacturers.

It stores the cumulated consumption value on a selectable due date and indicates this on the display for recording consumption costs.

The Q water 5.5 transmits the consumption values permanently by means of a radio signal via the integrated radio module to the QUNDIS remote meter read-out systems Q AMR and Q walk-by.

Parameter setting or manual read-out can also be carried out via the IrDA interface.

Application

The electronic water meter used for measuring water quantities. The main areas of application are in water supply systems where the water is outputted individually to different consumers.

This is meaningful in:

- › Apartment buildings
- › Offices and administration buildings

Typical users are:

- › Private building owners
- › Housing associations
- › Building service companies
- › Property management companies

Functions

- › Measurement of water consumption
- › Cumulation of the consumption values
- › Saving of the cumulated consumption values on the due date
- › Display of consumption values
- › Display of the most important operating data
- › Self-monitoring with error display
- › Data transmission by radio
- › Leak detection
- › Parameter setting and read-out via optical interface (IrDA-compatible)

Technology

Measuring principle

The counters work according to the multi-jet measuring principle. The water flow hits an impeller wheel tangentially; the speed of this wheel is scanned inductively via coils.

Storing the consumption values

The water consumption values are continually cumulated. The current status is stored at 23.59 h on the next due date. The due date can be programmed in the factory; December 31 is the default setting.

When the annual consumption is stored, the water meter calculates a checksum. Those who read the meter themselves must communicate this checksum together with the due date value read off to the evaluation office; it is used to check that the display has been read off correctly.


The stored due date value remains in place for one year.

Stored data

- › Current consumption value
- › Due date value
- › Due date
- › 13 monthly values
- › Error code
- › Error date
- › Current meter reading (reverse)

Displays

The water meter has a rolling display. This covers the following values and parameters:

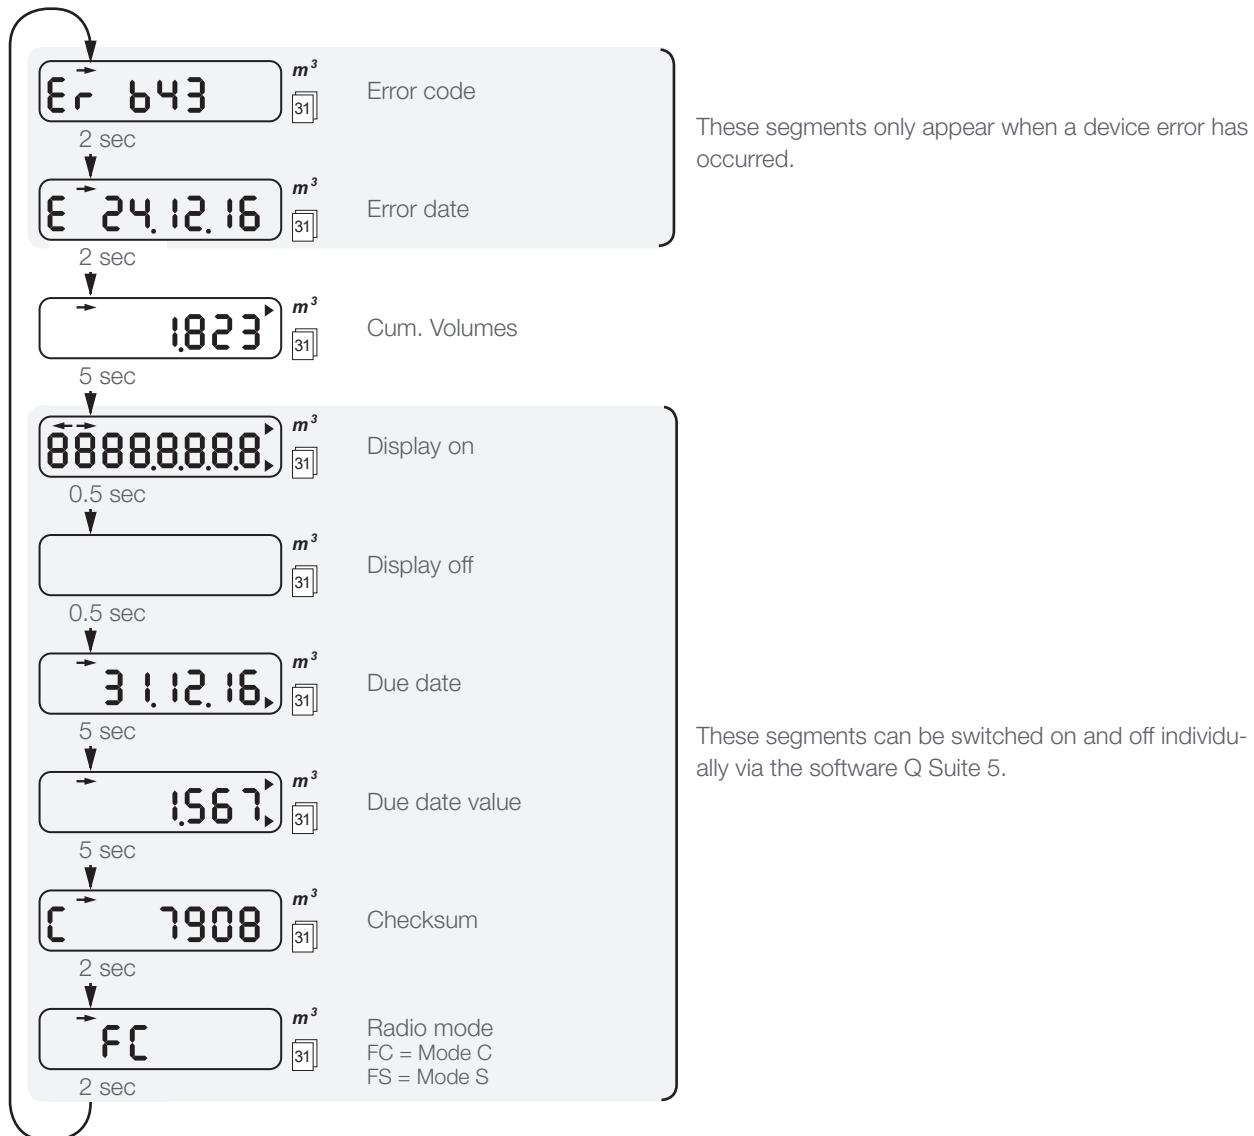

Version

The meter is made up of the measuring capsule and the calculator unit. The capsule is installed in the respective single-pipe connection piece (EAT). It is made of plastic and contains the measuring chamber with the multi-jet impeller wheel sensor.

Calculator unit

The calculator unit contains the electronics and the eight-digit display (LCD). The operating voltage of DC 3 V is provided by a lithium battery. There is an IrDA interface underneath the display for the automatic read-out of the meter values. The calculator unit can be turned through 360° on the volume meter.

Radio (wireless) features C-mode

- » Radio system – parallel transmission of Q walk-by and Q AMR data telegrams
- » Q walk-by: 365 days per year, 10 hours per day
- » Q AMR: every 7.5 minutes, 24 hours per day
- » Increased radio capacity up to 10 dBm
- » Possible to change from C-mode to S-mode

Transmission behaviour

Q walk-by	Q AMR⁽¹⁾
every 112 seconds	every 7.5 minutes
10 hours per day (8 am - 6 pm)	24 hours per day
365 days per year	365 days per year
current consumption values	current consumption values
13 Statistical values	

(1) OMS-conform data telegrams

Radio (wireless) features S-mode

- » Increased radio capacity
- » Radio system – parallel transmission of Q walk-by and Q AMR data telegrams
- » Q walk-by: 48 days per year, 10 hours per day
- » Q AMR: every 4 hours, 24 hours per day
- » Transmission delay (offset) or transmission-free days can be parameterized for Q walk-by
- » Possible to change from S-mode to C-mode

Transmission behaviour

Q walk-by	Q AMR
every 128 seconds	every 4 hours
10 hours per day (8 am - 6 pm)	24 hours per day
monthly: 4 readout days from the first of each month	7 days per week
annually: 48 hours after due date	365 days per year
current consumption values 13 Statistical values	Data telegrams only or statistics and consumption values

Technical data

General device data

Battery service life (depending on the battery load)	1 year storage, 10 years radio operation, 1 year reserve
Rated voltage	DC 3 V
Data transmission according to	EN 13757-4
Frequency band	
S Mode	868.3 MHz
C Mode	868.95 MHz
Transmission power	Typically 10 dBm
Duty cycle	< 1 % (50ms/128s)
Permissible ambient temperature during transport (2K3) on the basis of EN 60721-3-2:1997; during storage (1K3) on the basis of EN 60721-3-1:1997; in operation (3K4) on the basis of EN 60721-3-3:1997;	-25 °C to max. +70 °C -5 °C to +45 °C +5 °C to +55 °C

Standards and norms


CE conformity	2014/32/EU Measuring Instruments Directive: EN 14154:2005+A2:2011, EN 14154-1+A2:2011-04, EN 14154-2+A2:2011-04, EN 14154-3+A2:2011-04 2014/53/EU Radio Equipment Directive (RED) 2011/65/EU Restriction of the use of certain hazardous substances (RoHS): EN 50581:2012-09
Protection rating	IP 65 / IP 68 ^(*)
Protection class	III according to EN 61140
Radio	EN 300 220-1 V2.4.1:2012-05 EN 300 220-2 V2.4.1:2012-05
Electromagnetic compatibility	EN 301489-3 V1.6.1:2013-08 EN 301489-1 V1.9.2:2011-09 EN 60950-1: 2006 + A2:2013
Information technology equipment - Safety	EN 60950-1

(*) Tested according to manufacturer's specifications


Technical data

Meter type	WME5 xxxx 4	WME5 xxxx 6	WME5 xxxx 8	WME5 xxxx A	WME5 xxxx C	WME5 xxxx E	WME5 xxxx J	WME5 xxxx T	WME5 xxxx V	WME5 xxxx W	WME5 xxxx X
Meter size / permanent flowrate Q ₃	m ³ /h										2.5
corresponds to previous nominal size Q _n	m ³ /h										1.5
Suitable for EAT	IST	A34	TE1	MOC/MOE	MET /HT3	HT2	MB3	DM1	MJK	WE1	WGU
Connection thread	G2"	M77 x 1.5	M62 x 2	M65 x 2	M64 x 2	M66 x 1	M76 x 1.5	M60 x 2	G2 1/4"	M78 x 1.5	M66 x 1.25
Performance data											
Overload flowrate Q ₄	l/h										3,125
Transitional flowrate Q ₂ (H/V)	l/h										50/100
Minimum flowrate Q ₁ (H/V)	l/h										31.25/62.5
Measuring range (MID) Q ₃ /Q ₁ (H/M)											R80/R40
Permanent flowrate Q ₃	l/h										2,500
Temperature class MAT	°C										Cold water T30 Hot water T30/T90
Perm. operating pressure MAP	bar										16
Mechanical class											M1
Inflow/outflow zone											UO / DO


Dimensional drawing type IST - connection thread G2"

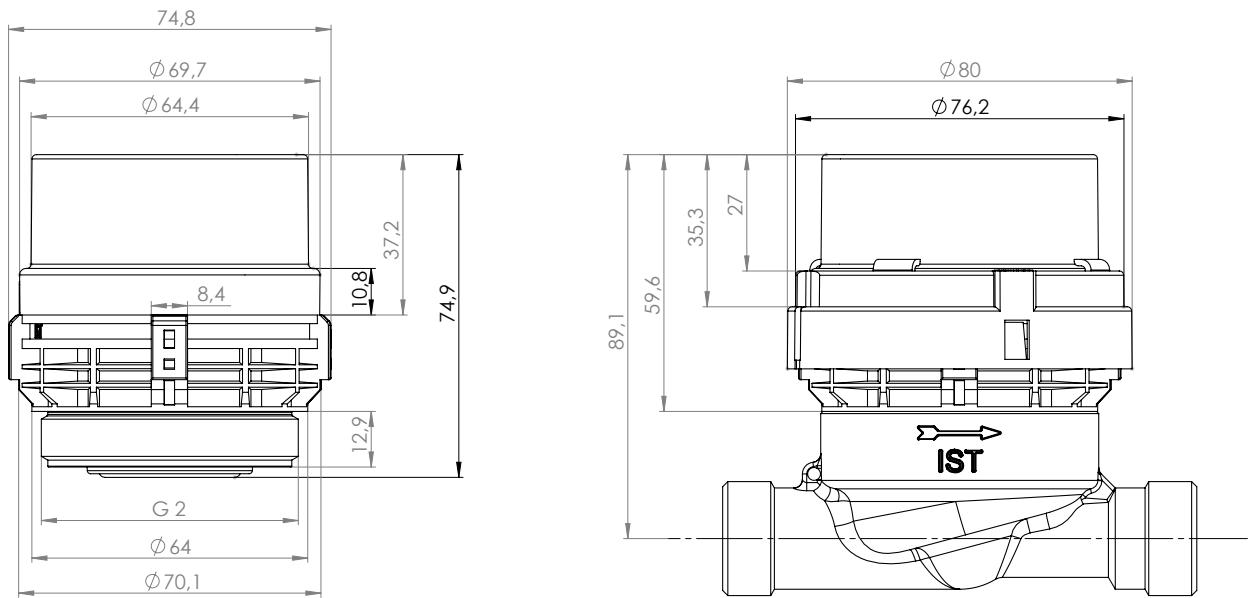


Dimensional drawing type A34 - connection thread M77 x 1.5

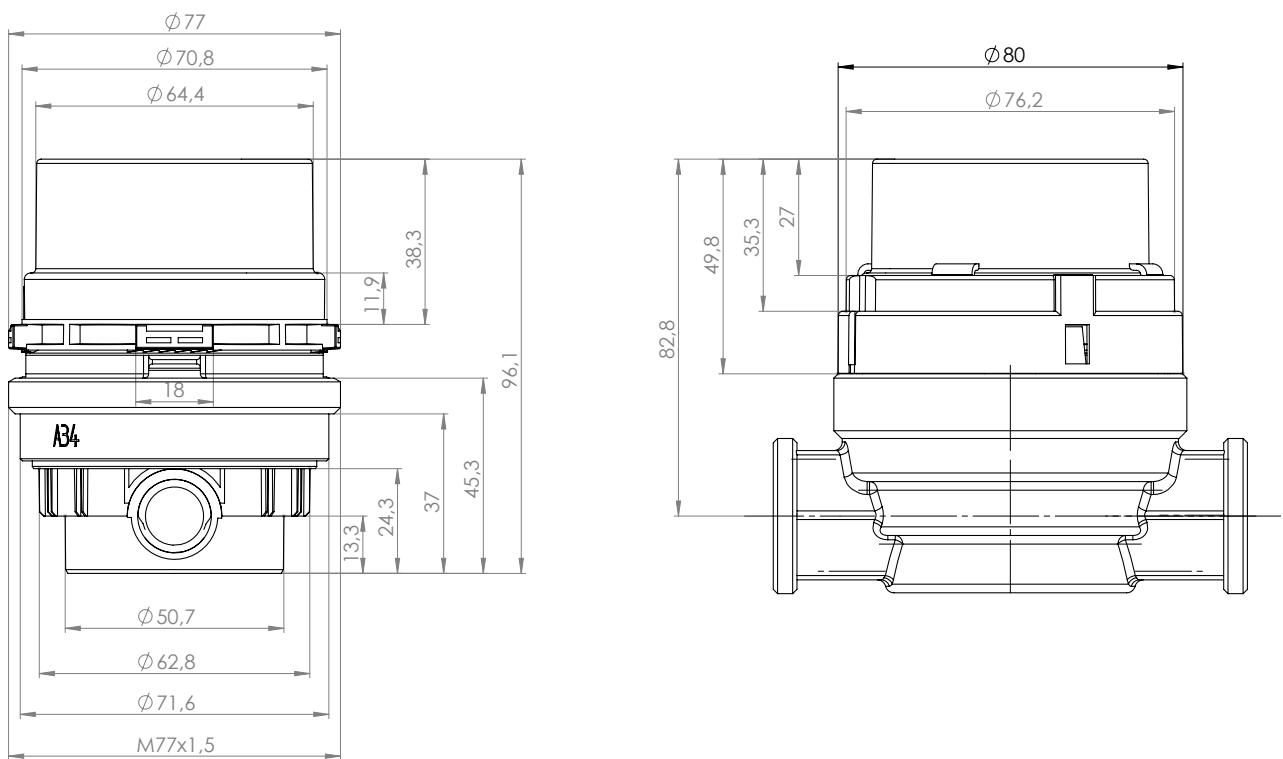


Dimensional drawing type TE1 - connection thread M62 x 2

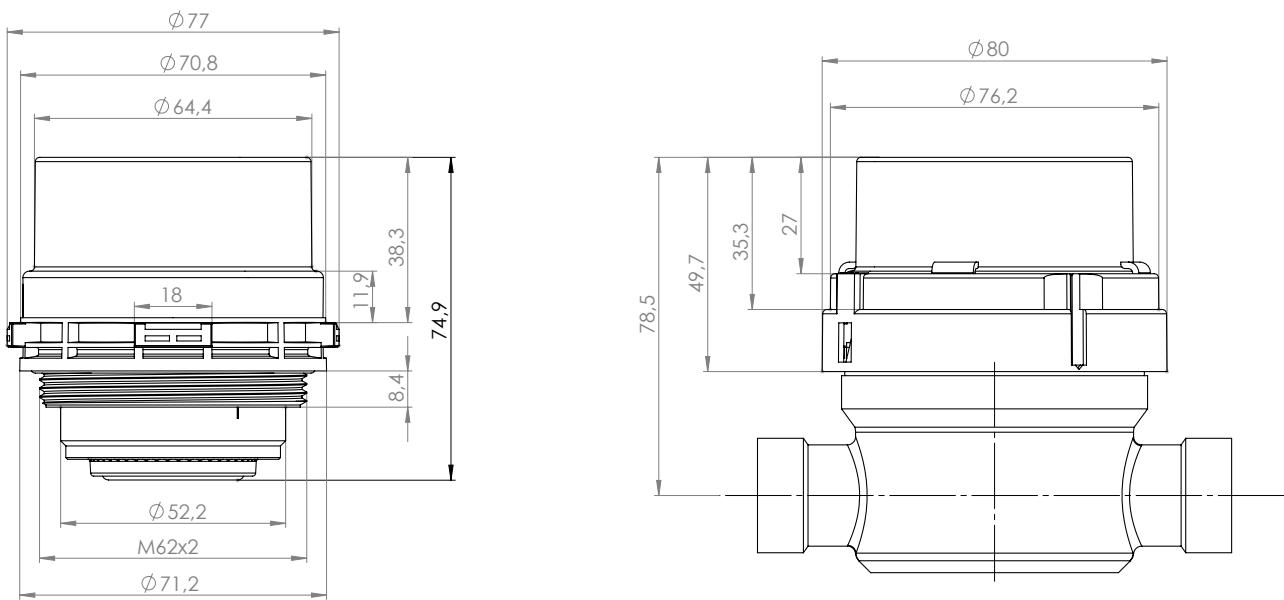


Dimensional drawing type MOC / MOE - connection thread M65 x 2

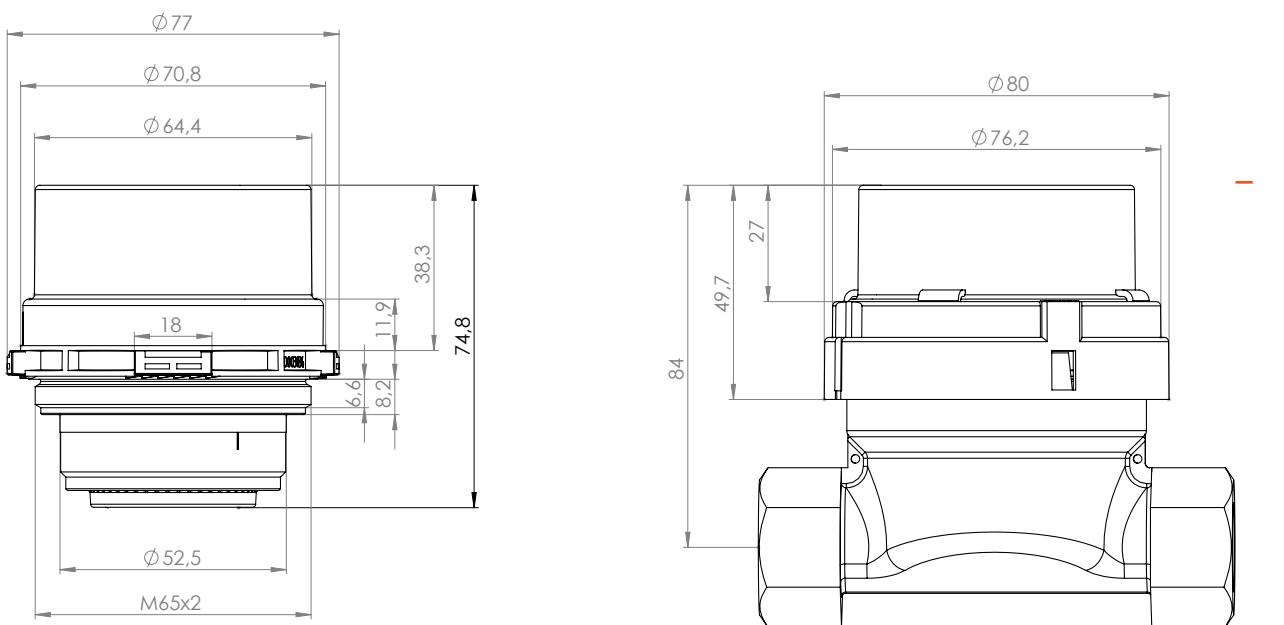


Dimensional drawing type MET / HT3 - connection thread M64 x 2

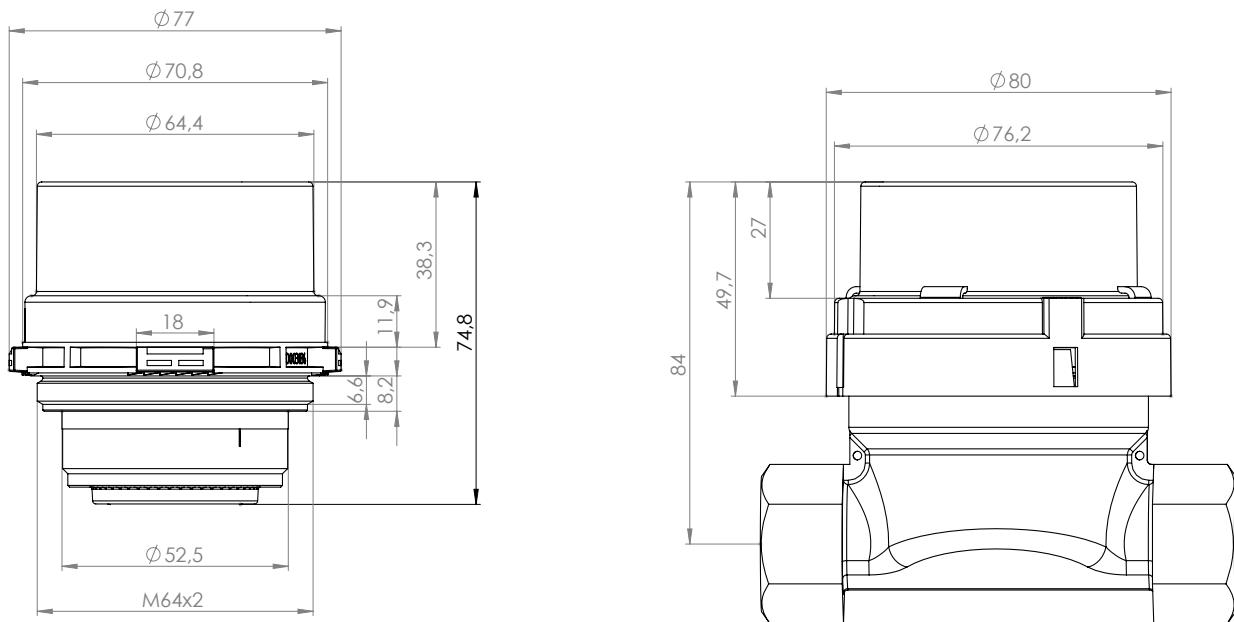


Dimensional drawing type HT2 - connection thread M66 x 1

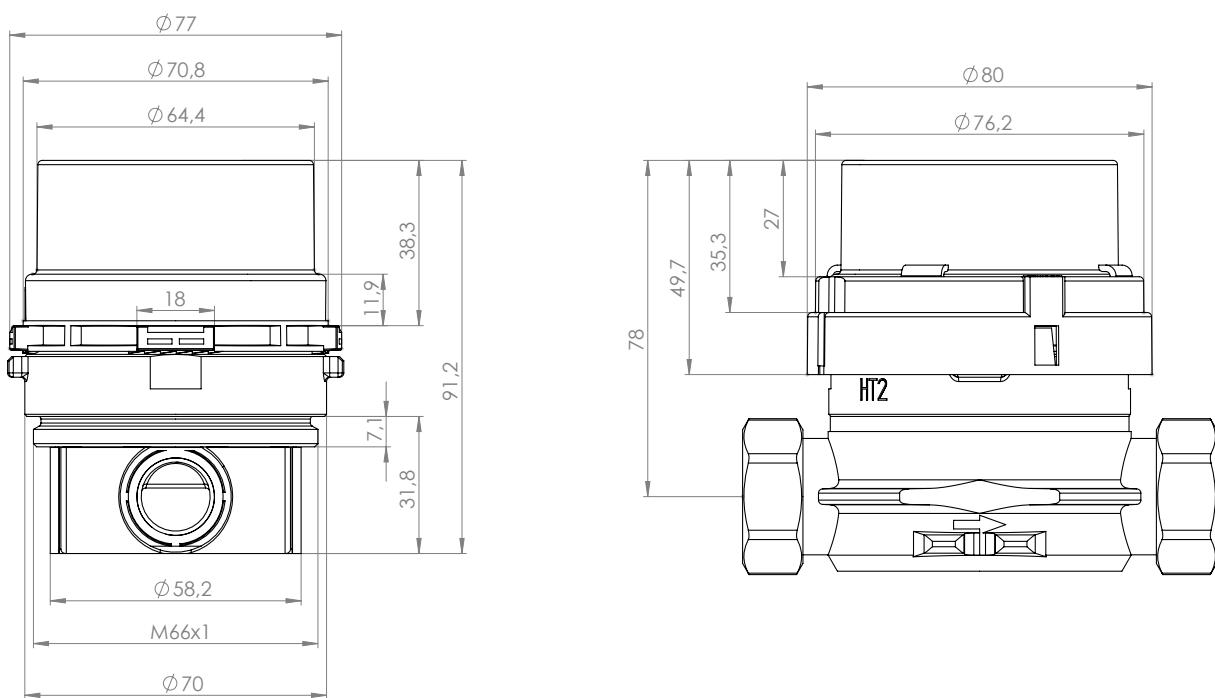


Dimensional drawing type MB3 - connection thread M76 x 1.5

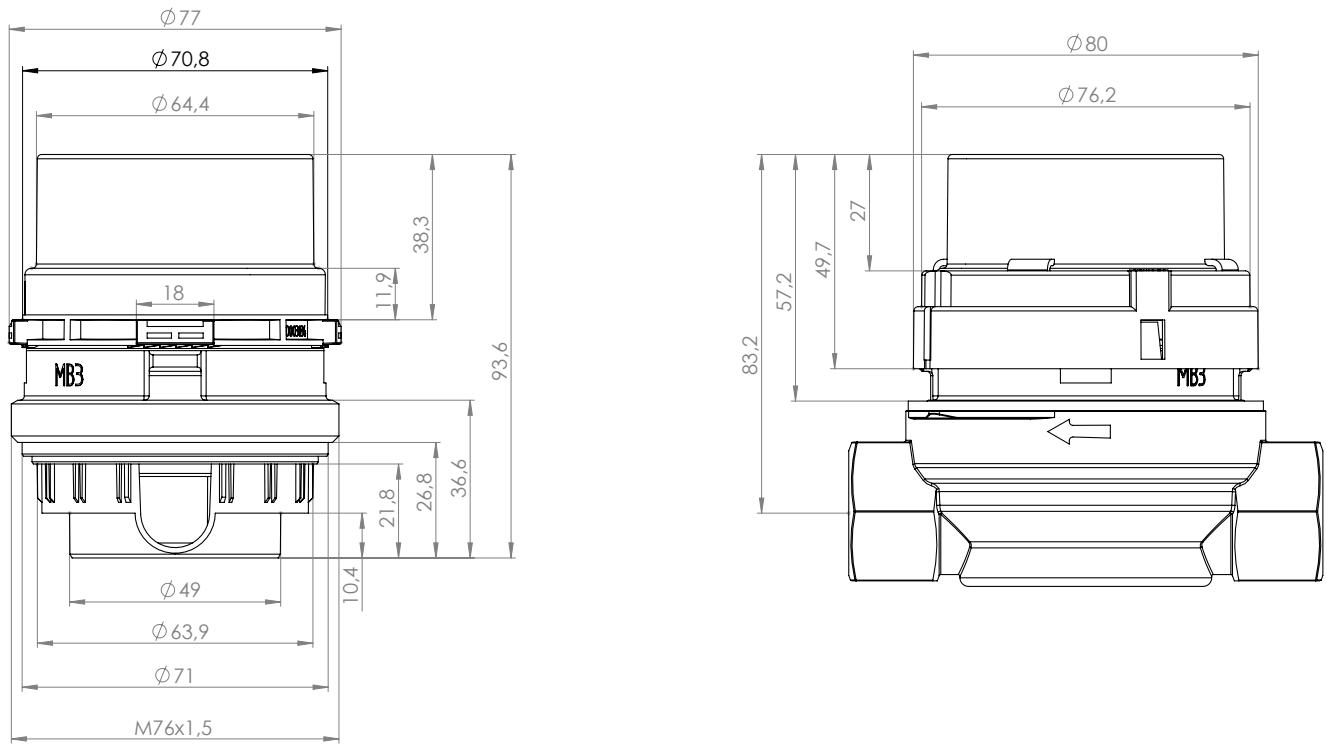


Dimensional drawing type DM1 - connection thread M60 x 2

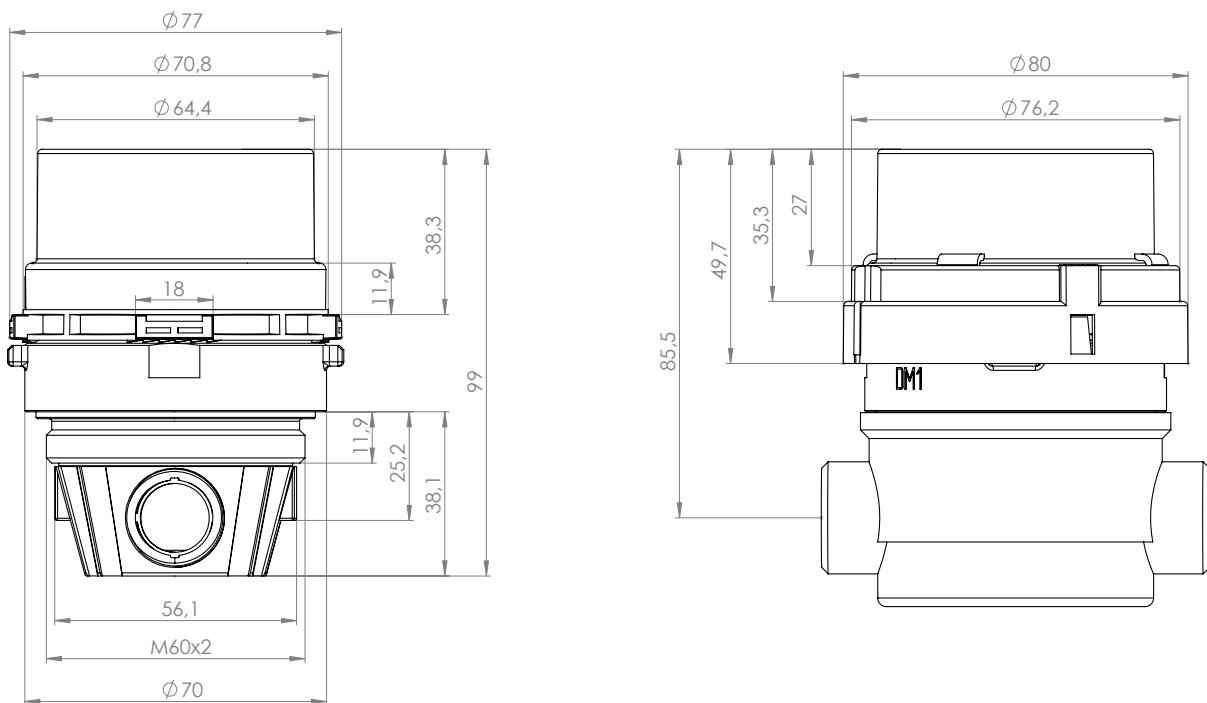


Dimensional drawing type MUK - connection thread G2 1/4"

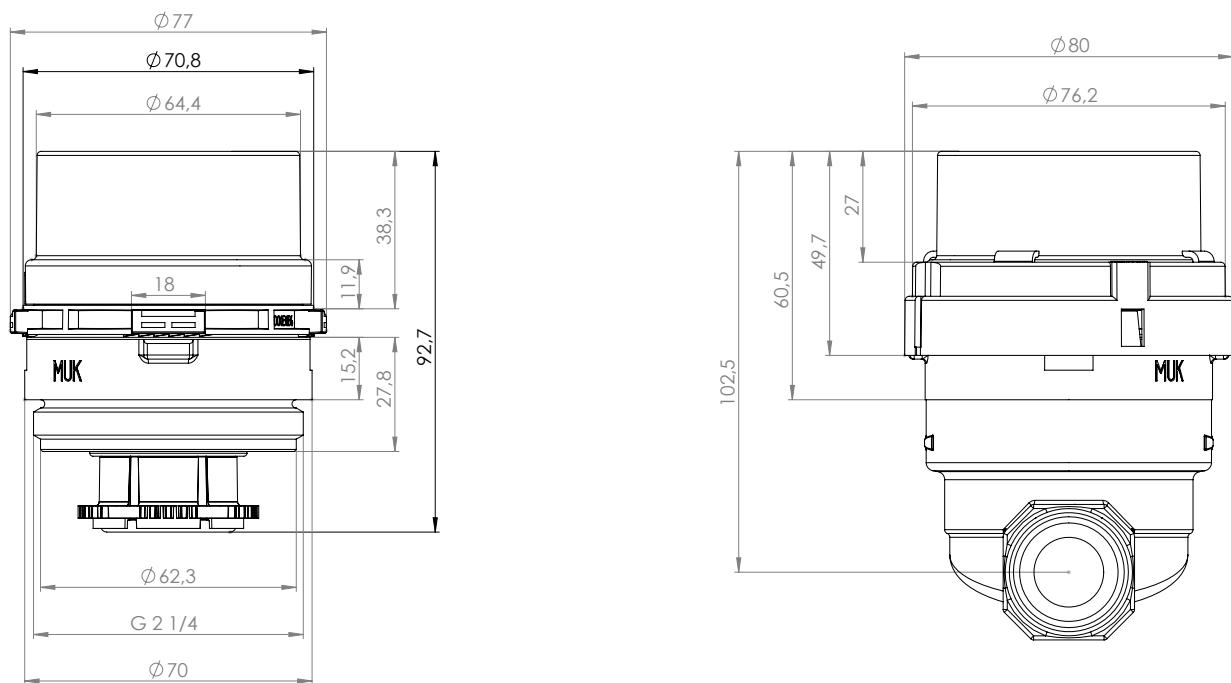

Dimensional drawing type WE1 - connection thread M78 x 1,5

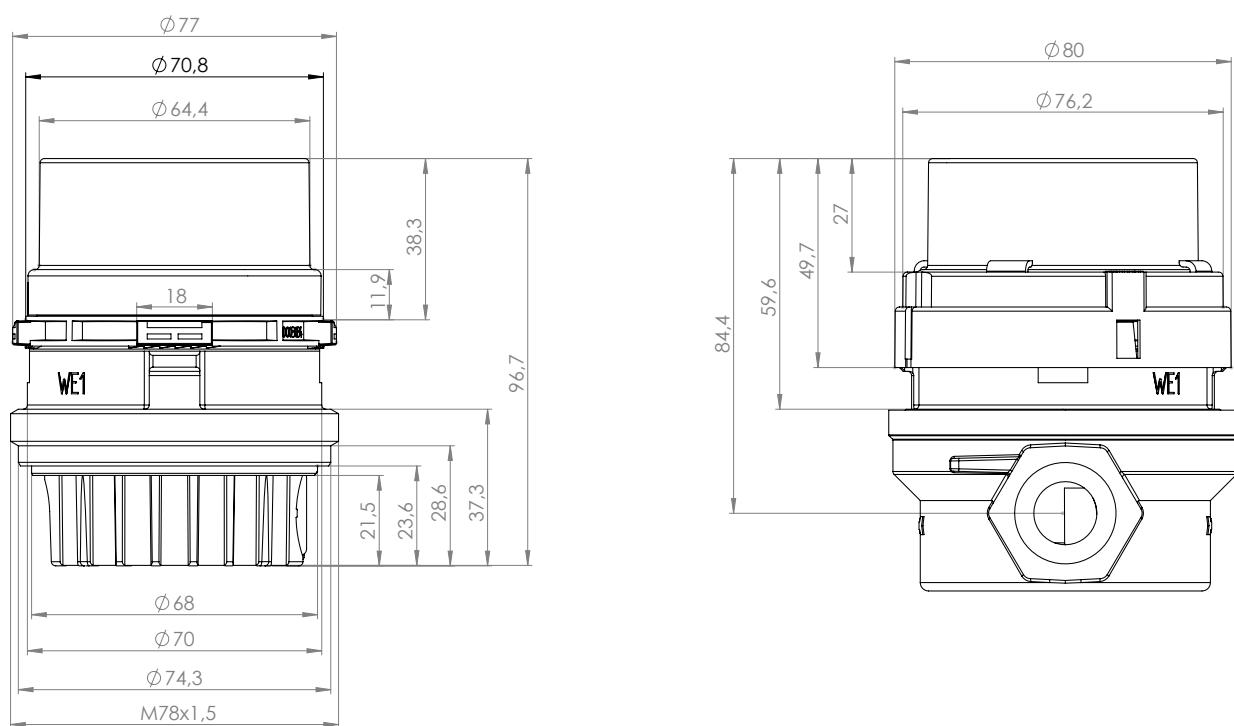

Dimensional drawing type WGU - connection thread M66 x 1,25

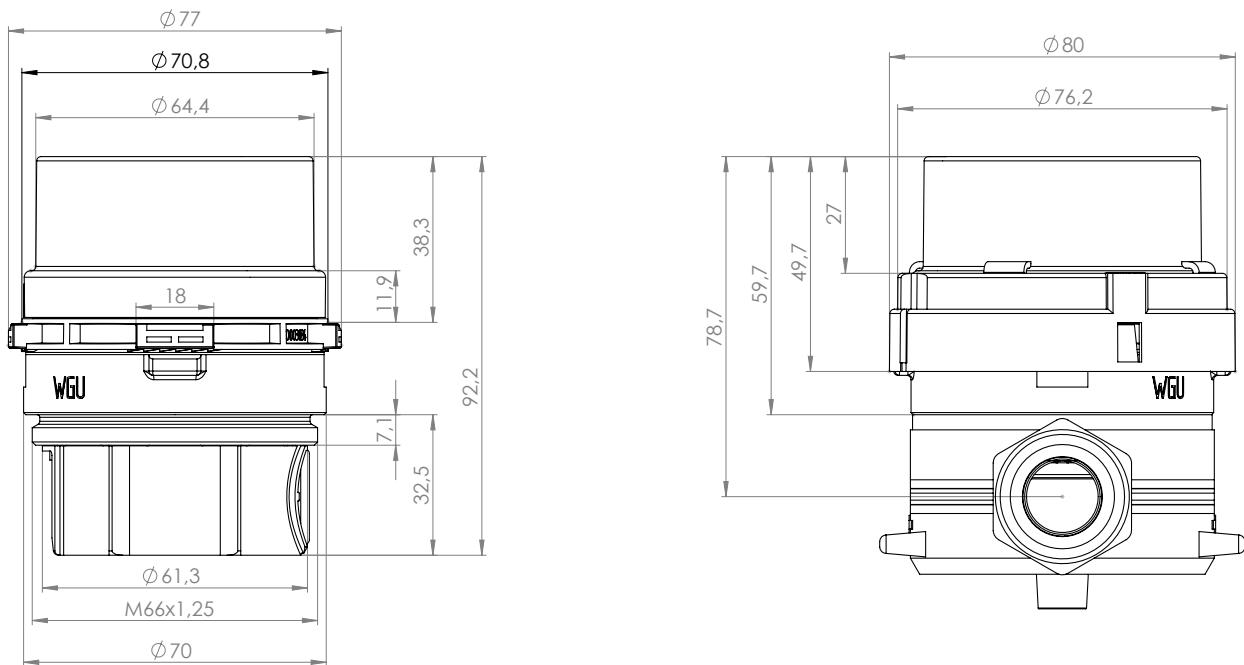

✉ QUNDIS GmbH

Sonnentor 2

D-99098 Erfurt

📞 +49 (0) 361 26 280-0

📠 +49 (0) 361 26 280-175

✉ info@qundis.com

www.qundis.com

The information in this data sheet only contains general descriptions or product characteristics, which may not always apply in particular application cases and/or may be subject to change through further development of the product. Required product characteristics are then binding if they are expressly agreed upon when the contract is drawn up.

©2017 QUNDIS GmbH. Subject to change